


any ftg on this flat must be connected with a flexible connector capable of a minimum 10° downward angle (NOTE ON DWG. REQUIRED)

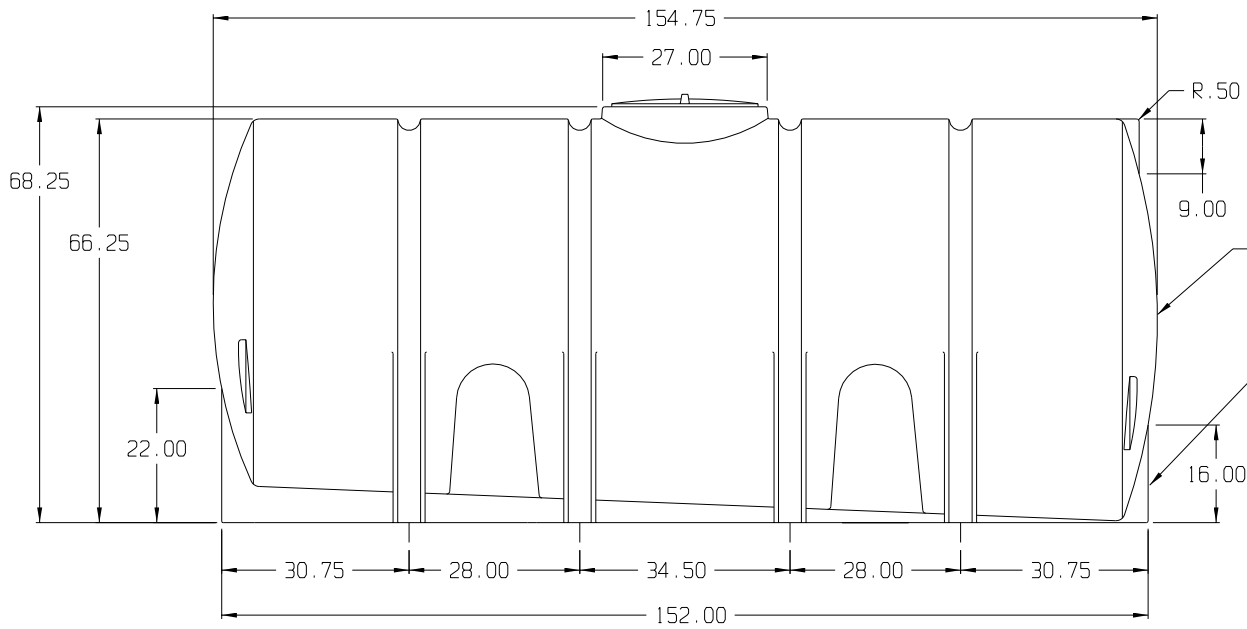

any ftg on this flat must be connected with a flexible connector capable of a minimum 10° downward angle (NOTE ON DWG. REQUIRED)

(all dimensions in inches)

BASE FITTINGS TO BE LEFT INSTALLED AT TIME OF SHIPMENT PER Sii PROCEDURE

PART # TANK: 8470--

2,600 GALLON HORIZONTAL LEG TANK

REF#: 0000

09/03/02